



City of Oviedo Fire/Rescue

400 Alexandria Blvd, Oviedo Florida 32765

Physical Location: 1934 West CR 419, Oviedo FL, 32766

Office: 407-971-5610 Fax: 407-971-5810

GENERAL REQUIREMENTS FOR ALL FOOD VENDORS

Due to DBPR regulations and the F.A.C. 61C-4.016, all cooking and food preparations shall be conducted under cover. This list is consisting of the main check points; however, it is your responsibility to follow all cooking requirements from the F.A.C. 61C-4.016 and State of Florida currently adopted edition of the Florida Fire Prevention Code.

- 1) There shall be a minimum clearance of 10 ft between all buildings, building overhangs, structures, vehicles, and any combustible materials.
- 2) All gas cylinders shall be properly restrained to avoid being displaced.
- 3) There shall be a min. of 1 **Florida Certified*** Fire Extinguisher with each food vendor: Min. 2A:10BC
- 4) There shall be a **Florida Certified*** Class K Fire Extinguisher for all cooking operations that produce grease laden vapors.
- 5) If cooking is to occur under a tent/canopy, the tent shall be of an approved flame-resistant material that is compliant with the currently adopted edition of NFPA 701 standards. **The label shall be permanently affixed to the tent showing the fire-resistant treatment or rating approval.** If not cooking under a tent/canopy, the cooking operation shall be conducted a minimum 10 feet away (see #1).
- 6) All fixed cooking equipment that is protected by a fixed fire suppression system shall be inspected by a licensed fire suppression company every 6 months.
- 7) All exhaust from engine-driven source of power shall be at least 10 ft in all directions from openings and air intakes.

FYI - ALL FOOD TRUCKS, TRAILERS AND TENTS SHALL BE INSPECTED ON THE DAY OF THE EVENT THAT YOU ARE PARTAKING IN. YOU SHALL ARRIVE TO THE EVENT AND BE SETTING UP NO LESS THAN 1.5 HOURS PRIOR TO THE STARTING TIME OF THE EVENT.

PLEASE BE AWARE Fire extinguishers purchased from a hardware store do not come certified by a licensed State of Florida fire extinguisher company; therefore, you will need to contact a local licensed fire extinguisher contractor for this service. Fire Extinguishers shall be certified annually.

NON-COMPLIANCE WITH ANY OF THE ABOVE WILL BE CAUSE FOR THE OVIEDO FIRE PREVENTION DIVISION TO IMMEDIATELY STOP ALL OPERATIONS UNTIL FULL COMPLAINE IS MET OR BUSINESS WILL BE ASKED TO LEAVE.

I have read and will comply with the requirements listed above.

<i>Event Name</i>		<i>Company Name</i>	
<i>Address</i>	<i>City</i>	<i>State</i>	<i>Zip</i>
<i>Contact Phone Number</i>		<i>Email address</i>	
<i>Print</i>		<i>Sign/Date</i>	

If you have any questions, please contact the City of Oviedo at 407-971-5588 prior to the day of the event. EMAIL FORMS TO – Sarah Jones (SJONES@CITYOFOVIEDO.NET) and cc Nichlaus Dorey (NDOREY@CITYOFOVIEDO.NET)



City of Oviedo Fire/Rescue

400 Alexandria Blvd, Oviedo Florida 32765
Physical Location: 1934 West CR 419, Oviedo FL, 32766



Fire Prevention Division

FLORIDA SPECIFIC FOOD TRUCK TRAINING REQUIREMENTS

**Florida Fire Prevention Code, 7th Edition
NFPA 1, 2018 Edition:**

50.7.1.9 Training

50.7.1.9.1*

Prior to performing mobile or temporary cooking operations, workers shall be trained in emergency response procedures including:

- (a) proper use of portable fire extinguishers and extinguishing systems
- (b) proper method of shutting off fuel sources
- (c) proper procedure for notifying the local fire department
- (d) proper refueling
- (e) how to perform leak detection
- (f) fuel properties

A.50.7.1.9.1

*An approved method of leak detection would include pressurizing the LP-Gas system with LP-Gas and utilizing a gas meter to detect the presence of LP-Gas around the tank, piping and appliances.

50.7.1.9.2


Refresher training shall be provided every year.

50.7.1.9.3

Initial and refresher training shall be documented and made available to the AHJ upon request.



FOOD TRUCK SAFETY

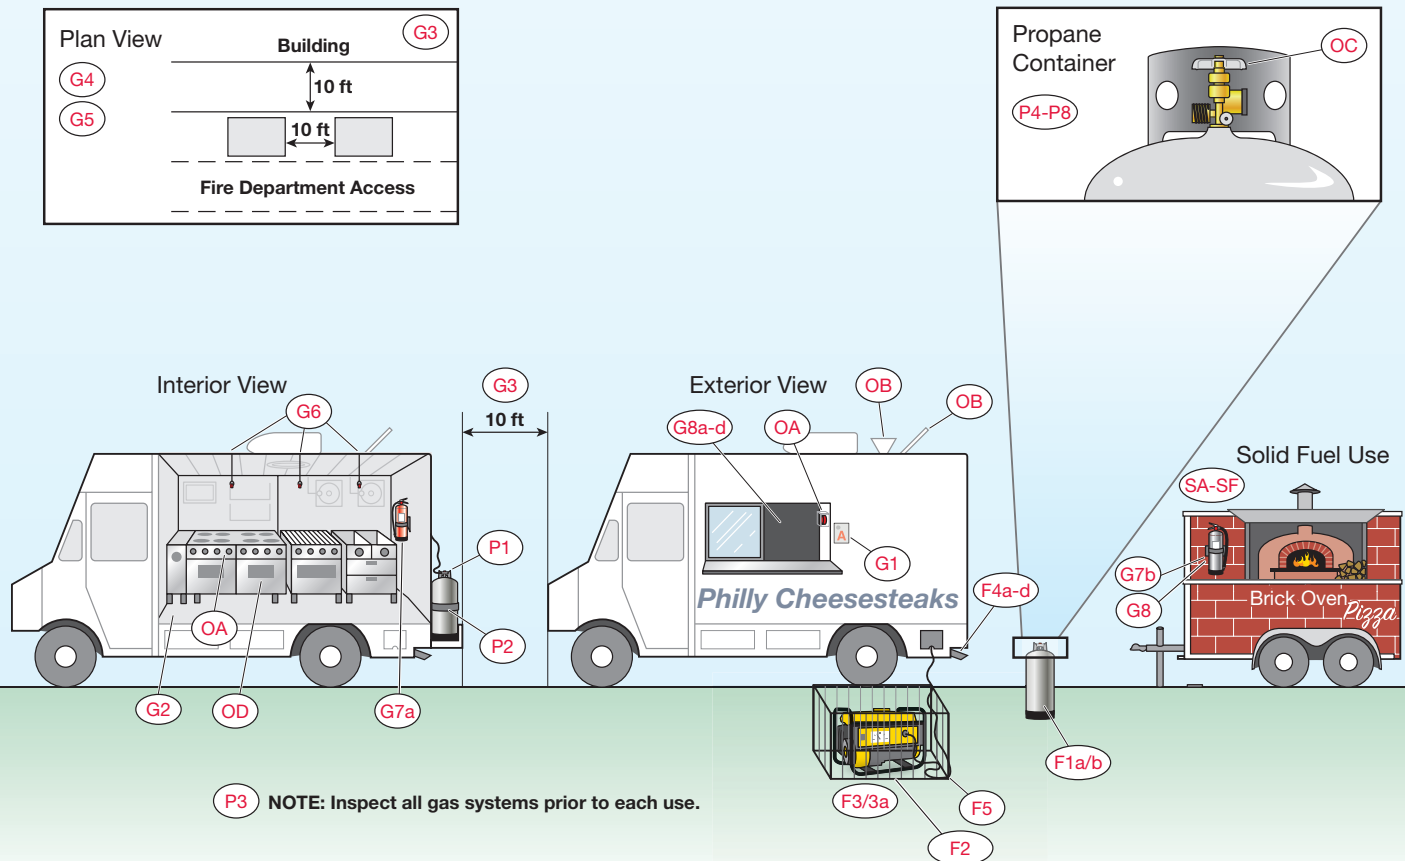

NFPA code references are provided at the end of each item. The red keys correspond to the NFPA food truck safety diagram. For more detailed information, see NFPA 1 and Annex B in NFPA 96.

General Safety Checklist

- ☐ Obtain license or permits from the local authorities. [1:1.12.8(a)] **G1**
- ☐ Ensure there is no public seating within the mobile food truck. [1:50.7.1.6.3] **G2**
- ☐ Check that there is a clearance of at least 10 ft away from buildings, structures, vehicles, and any combustible materials. [96:7.8.2; 96:7.8.3 for carnivals only] **G3**
- ☐ Verify fire department vehicular access is provided for fire lanes and access roads. [1:18.2.4] **G4**
- ☐ Ensure clearance is provided for the fire department to access fire hydrants and access fire department connections. [1:13.1.3; 1:13.1.4; 1:13.1.5] **G5**
- ☐ Check that appliances using combustible media are protected by an approved fire extinguishing system. [96:10.1.2] **G6**
- ☐ Verify portable fire extinguishers have been selected and installed in kitchen cooking areas in accordance with NFPA 10. [96:10.9.3] **G7a**
- ☐ Where solid fuel cooking appliance produce grease-laden vapors, make sure the appliances are protected by listed fire-extinguishing equipment. [96:14.7.1] **G7b**
- ☐ Ensure that workers are trained in the following: [96:B.15.1] **G8**
 - ☐ Proper use of portable fire extinguishers and extinguishing systems [10:1.2] **G8a**
 - ☐ Proper method of shutting off fuel sources [96:10.4.1] **G8b**
 - ☐ Proper procedure for notifying the local fire department [1:10.14.9 for carnivals only] **G8c**
 - ☐ Proper procedure for how to perform simple leak test on gas connections [58:6.16, 58:6.17] **G8d**



FOOD TRUCK SAFETY *CONTINUED*

Fuel & Power Sources Checklist

- ☐ Verify that fuel tanks are filled to the capacity needed for uninterrupted operation during normal operating hours. [1:10.14.10.1 for carnivals only] **F1a**
- ☐ Ensure that refueling is conducted only during non-operating hours. [96:B.18.3] **F1b**
- ☐ Check that any engine-driven source of power is separated from the public by barriers, such as physical guards, fencing, or enclosures. [96:B.16.2.2] **F2**
- ☐ Ensure that any engine-driven source of power is shut down prior to refueling from a portable container. [1:11.7.2.1.2] **F3**
- ☐ Check that surfaces of engine-driven source of power are cool to the touch prior to refueling from a portable container. **F3a**
- ☐ Make sure that exhaust from engine-driven source of power complies with the following: **F4**
 - ☐ At least 10 ft in all directions from openings and air intakes [96:B.13] **F4a**
 - ☐ At least 10 ft from every means of egress [96:B.13] **F4b**
 - ☐ Directed away from all buildings [1:11.7.2.2] **F4c**
 - ☐ Directed away from all other cooking vehicles and operations [1:11.7.2.2] **F4d**
- ☐ Ensure that all electrical appliances, fixtures, equipment, and wiring complies with the NFPA 70® [96:B.18] **F5**

Propane System Integrity Checklist

- ☐ Check that the main shutoff valve on all gas containers is readily accessible. [58:6.26.4.1(3)] **P1**
- ☐ Ensure that portable gas containers are in the upright position and secured to prevent tipping over. [58:6.26.3.4] **P2**
- ☐ Inspect gas systems prior to each use. [96:B.19.2.3] **P3**
- ☐ Perform leak testing on all new gas connections of the gas system. [58:6.16; 58:6.17] **P4**
- ☐ Perform leak testing on all gas connections affected by replacement of an exchangeable container. [58:6.16; 58:6.17] **P5**
- ☐ Document leak testing and make documentation available for review by the authorized official. [58:6.26.5.1(M)] **P6**
- ☐ Ensure that on gas system piping, a flexible connector is installed between the regulator outlet and the fixed piping system. [58:6.26.5.1(B)] **P7**
- ☐ Where a gas detection system is installed, ensure that it has been tested in accordance with the manufacturer's instructions. [96:B.19.2.1] **P8**

Operational Safety Checklist

- ☐ Do not leave cooking equipment unattended while it is still hot. (This is the leading cause of home structure fires and home fire injuries.) **OA**
- ☐ Operate cooking equipment only when all windows, service hatches, and ventilation sources are fully opened. [96:14.2.2; 96:14.2.3] **OB**
- ☐ Close gas supply piping valves and gas container valves when equipment is not in use. [58:6.26.8.3] **OC**
- ☐ Keep cooking equipment, including the cooking ventilation system, clean by regularly removing grease. [96:11.4] **OD**

Solid Fuel Safety Checklist (Where Wood, Charcoal, Or Other Solid Fuel Is Used)

- ☐ Fuel is not stored above any heat-producing appliance or vent. [96:14.9.2.2] **SA**
- ☐ Fuel is not stored closer than 3 ft to any cooking appliance. [96:14.9.2.2] **SB**
- ☐ Fuel is not stored near any combustible flammable liquids, ignition sources, chemicals, and food supplies and packaged goods. [96:14.9.2.7] **SC**
- ☐ Fuel is not stored in the path of the ash removal or near removed ashes. [96:14.9.2.4] **SD**
- ☐ Ash, cinders, and other fire debris should be removed from the firebox at regular intervals and at least once a day. [96:14.9.3.6.1] **SE**
- ☐ Removed ashes, cinders, and other removed fire debris should be placed in a closed, metal container located at least 3 ft from any cooking appliance. [96:14.9.3.8] **SF**

NFPA RESOURCES

NFPA 1, *Fire Code*, 2018 Edition

NFPA 1 *Fire Code Handbook*, 2018 Edition

NFPA 58, *Liquefied Petroleum Gas Code*, 2017 Edition

LP-Gas Code Handbook, 2017 Edition

NFPA 70®, *National Electrical Code*®, 2017 Edition

National Electrical Code® *Handbook*, 2017 Edition

NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2017 Edition

NFPA 96: *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations Handbook*, 2017 Edition

➔ **BECOME AN NFPA MEMBER**
FOR MORE OF THESE RESOURCES



IT'S A BIG WORLD.
LET'S PROTECT IT TOGETHER.®

NOTE: This information is provided to help advance safety of mobile and temporary cooking operations. It is not intended to be a comprehensive list of requirements for mobile and temporary cooking operations. Check with the local jurisdiction for specific requirements. This safety sheet does not represent the official position of the NFPA or its Technical Committees. The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever resulting from the use of this information. For more information, go to nfpa.org/foodtrucksafety.

© 2018 National Fire Protection Association / August 2018